

شماره	معلومات ابتدایه ضروری هنگام سروی	درج معلومات به اساس سروی از ساحه
1	Site ID (آی دی سایت)	KBL059
2	کاندید شماره	1
3	GPS coordinates	34.546956° 69.131251°
4	نام ساحه و منطقه	Nawad Family
5	نام ولسوالی و ولایت مربوطه	Nawad Family
6	(نام ساحاتی که قرار است تحت پوشش سایت بیایند)	Nawad Family
7	مالیکت زمین (شخصی یا دولتی)	privete
8	مالک جایداد/خانه قابل دسترس است	0785978158//0973073500/ Khuja Rohullah 0783100637
9	شماره تماس مالک یا سکنه جایداد	privete
10	شخصی/کرای	privete
11	مالک جایداد با نصب سایت و شرایط افغان تیلی کام راضی است	privete
12	موافقه ابتدایی ساحوی با مالک جایداد صورت گرفت؟	privete
13	نوعیت سایت (سریام یا روی مین)	RT
14	جگونگی ساحه (شهری، روستایی، دوردست) یا VIP	City
15	سرک که واسطه نقلیه تردد بتواند دارد	no
16	آیا به سرک جهت تردد واسطه ضرورت است	No
17	چه مقدار سرک تردد واسطه ضرورت است (به متر)	no
18	در صورتیکه کاندید سایت سریام تعمیرات باشد	
19	نوعیت تعمیر (مسکونی/تجارتی)	
20	تعداد منازل	
21	ارتفاع تعمیر	
22	راه رسیدن به بام (زینه پیرونی داخلی)	
23	امکان جابجایی وسایل سریام با افراد و کارگرها است؟	
24	امکان جابجایی وسایل سریام با کرین است؟	
25	ظاهراً تعمیر قابلیت برداشت سیات را دارد؟	
26	نوعیت سریام (رنگ کانکریتی یا گادری)	
27	مساحت موجود سریام (طول و عرض)	
28	تاور مورد نیاز (گاید ماست کیبلی)	RT
29	ارتفاع تاور مورد نیاز	15m
30	ارتفاع مجموعی تاور و تعمیر از سطح زمین منزل	15m
31	در صورتیکه کاندید سروی در حویلی یا زمین جایداد باشد	15
32	نوعیت ساحه (ساحه باز یا ساحه محاط)	privete
33	مساحت موجود (طول و عرض)	10*10m

10*10m	مساحت مورد نیاز سایت (طول عرض)	34
Yes	نوعیت احاطه در صورت ضرورت	35
Yes	محل بودباش گارد در صورت ضرورت	36
RT	تاوور (کیبلی روی زمین یا سلف سپورت)	37
15	ارتفاع تاوور مورد نیاز	38
Relocation	امکانات وصل ترانس میشن سایت (TX type)	39
Yes	سایه بان و سلب برای وسایل مخابراتی (BTS and all racks)	40
Yes	سایه بان و سلب مورد نیاز جنراتور و تانکر	41
Yes	امکانات نصب سولر است؟	42
Yes	ساحه کافی برای سول موجود است؟	43
Yes	برق شهری در ساحه وجود دارد؟	44
Yes	فاصله برج برق از ساحه سایت	45
Jamshid	تیم سروی	46
Jamshid	نام	47
RF Engineer	دیپارتمنت	48
744441973	شماره	49
Yes	سکچ ساحه سایت (ترتیب و ضم رپور سروی شود)	50
Yes	عکسهای پانارومیک از ساحه گرفته شود	51
Yes	خط دید وصل مایکرویف با تیم از ساحه باید چک و تایید شود	52
Yes	خدمات سلام در ساحه موجود است؟	53
No	کیفیت خدمات سلام در ساحه	54
New Coveriag Site	معلومات اضافی و نظریات دیگر	55

REVISION RECORDS			
REVISION NO	DATE	DESCRIPTION	
01	25/03/2025	ISSUE DATE	

LEGEND:

	DRAWN ROCK	25
	POC	25
	ROOM TYPE	25

PROJECT TITLE / NO:

GSM SITES

موقع GSM

DRAWING TITLE:

SITE PLAN

مخطط الموقع

DRAWN BY:

CIVIL TEAM

CHECKED BY:

APPROVED BY:

SCALE:

1:75

ACTUAL DATE:

25/03/2025

ISSUE DATE:

DRG.NO: 01


OWNER:

AFGHAN TELECOM

مالك الموقع:

Sakari Telecommunication Company

KABUL AFGHANISTAN

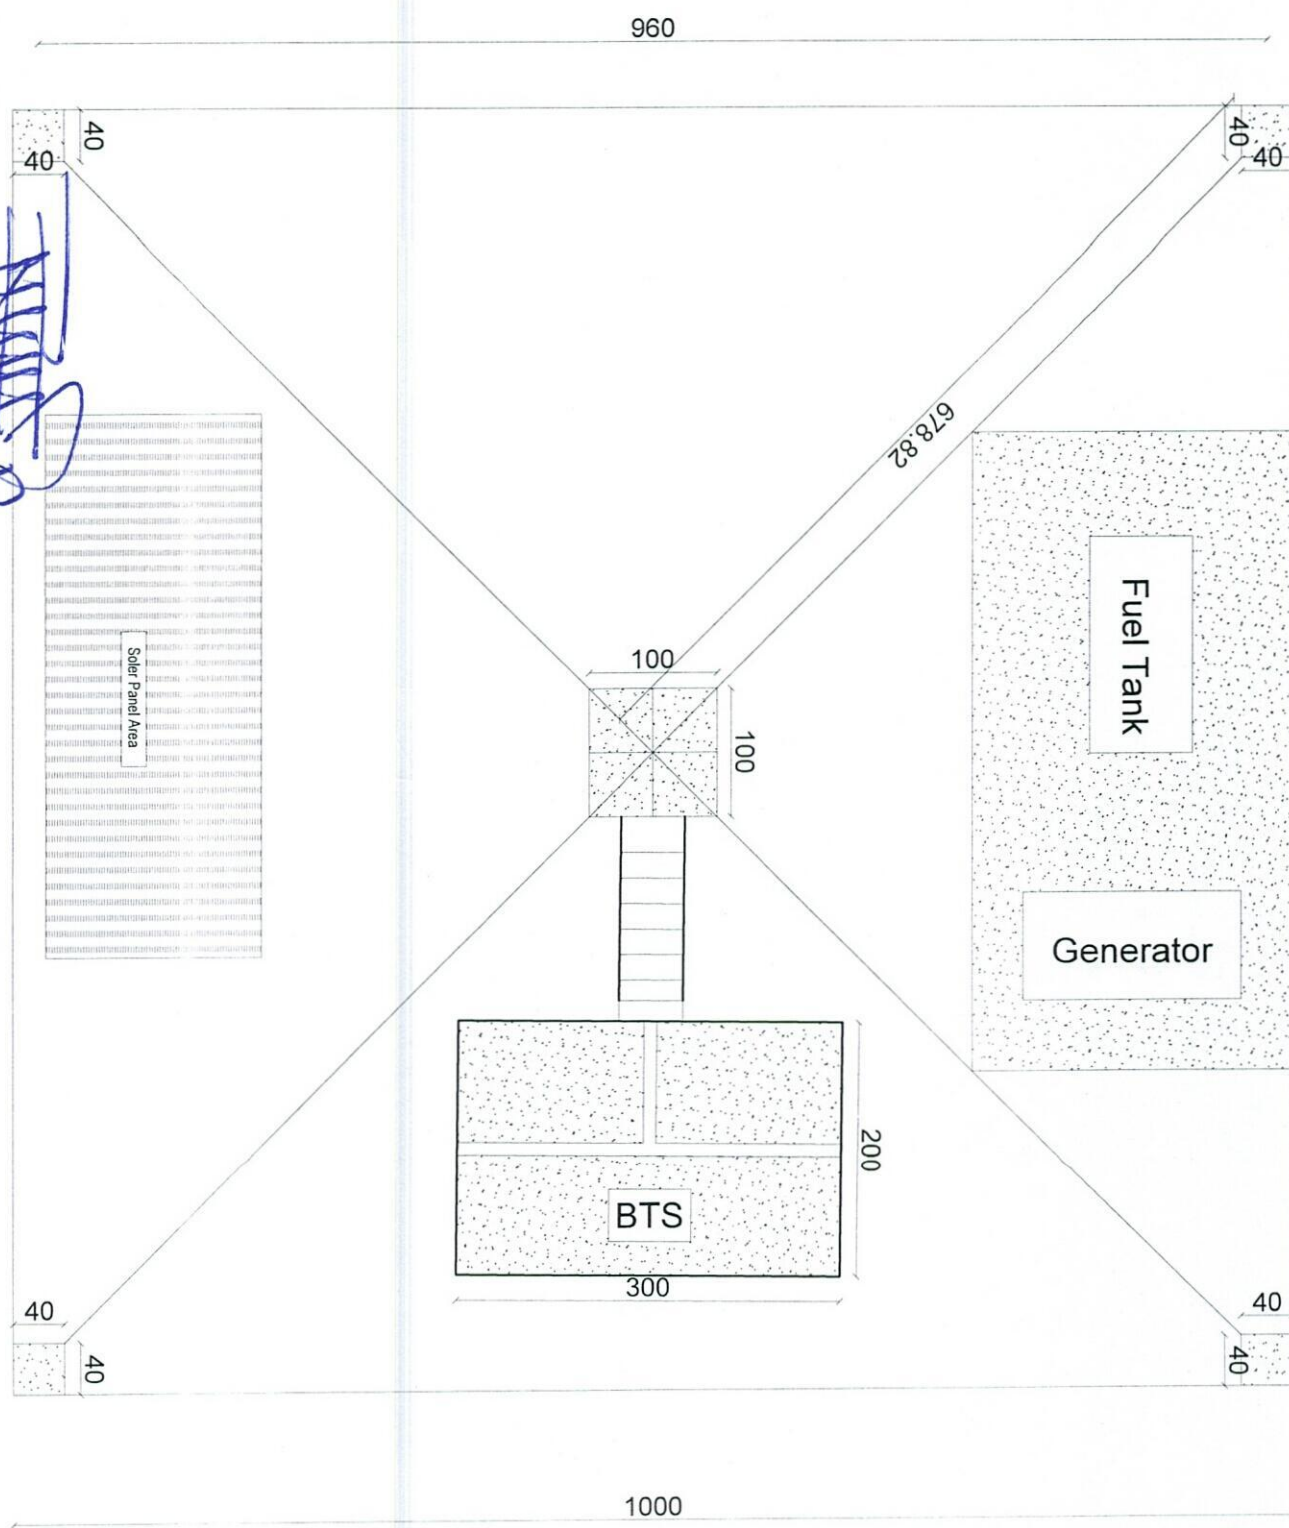


01 SITE PLAN
REF. A101


REVISION RECORDS	
REVISION NO	DESCRIPTION
01	ISSUED FOR PERMIT
02	ISSUED FOR CONSTRUCTION

LEGEND:	
	Concrete C20
	Crushed Rock
	10cm Crush Stone
	Rebar
	GROUND LEVEL


- Notes:
1. The foundation is adopts reinforced concrete, the concrete is C20; (C20:compressive strength is 20N/mm²); the foundation lays on a 10cm thick crush stone pad;
 2. Ø12: mild steel, rebars strength 210N/mm²
 3. minimum concrete cover for rebar is 3.5cm,
 4. All units are in cm
 5. All edges of the Slab should be curve

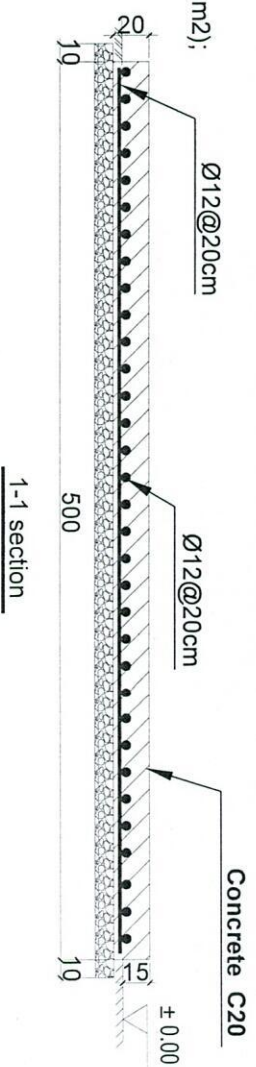

1-1 section

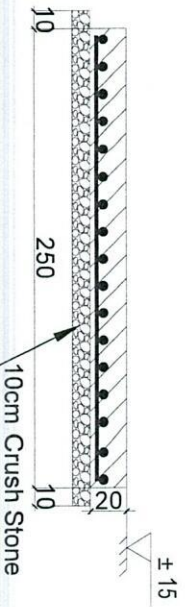

2-2 section

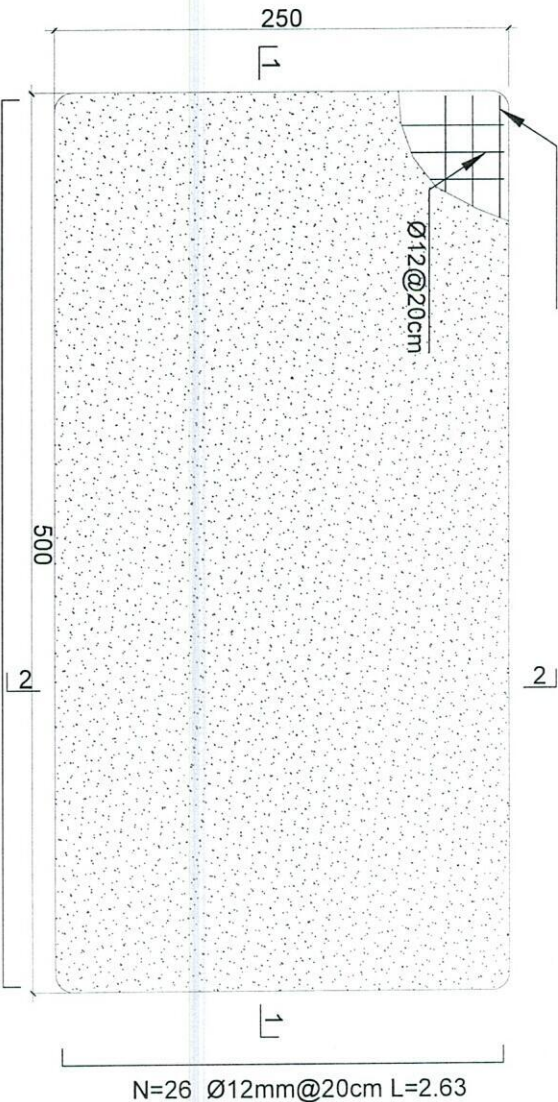

Generator Foundation

GENERATOR FOUNDATION
SCALE: 1:25

PROJECT TITLE / NO:
GSM SITES
محل نصب دستگاه GSM

DRAWING TITLE:
GENERATOR FOUNDATION
محل نصب دستگاه




DRAWN BY:
CIVIL TEAM
چک شده توسط

CHECKED BY:
APPROVED BY:
مهندس


SCALE: 1:25
ACTUAL DATE: 25/03/2025
ISSUE DATE:
DRG.NO: 02

OWNER:
AFGHAN TELECOM
شرکت مخابرات افغانستان

Sakom Telecommunication Company
KARUL
AFGHANISTAN

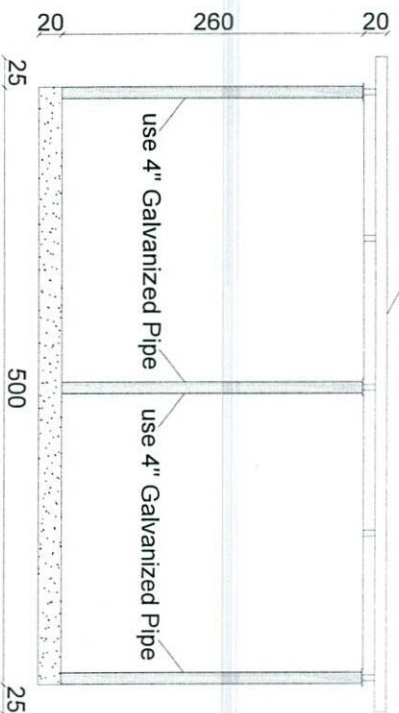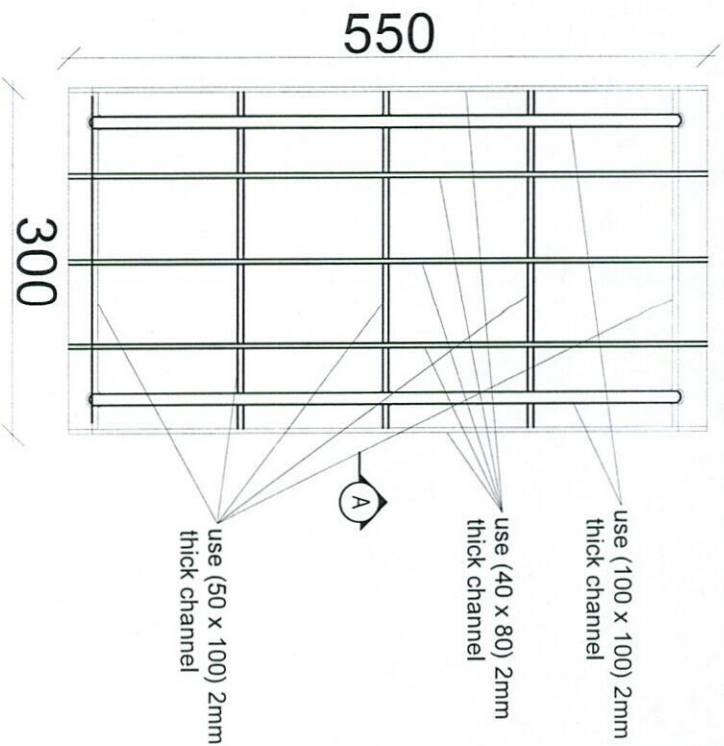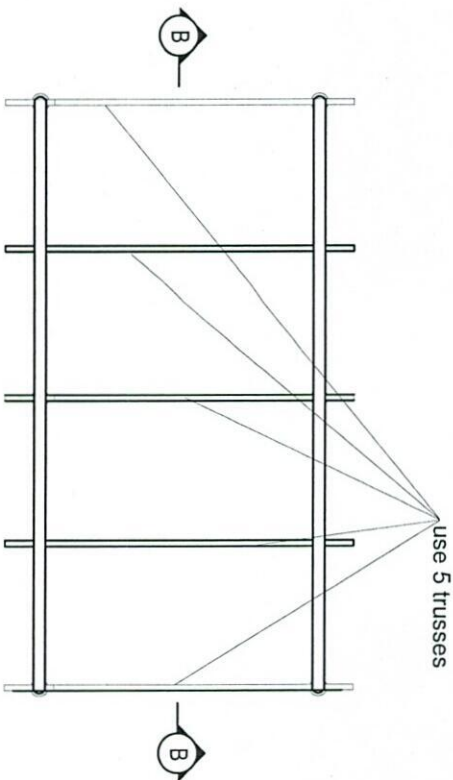

Section B-B

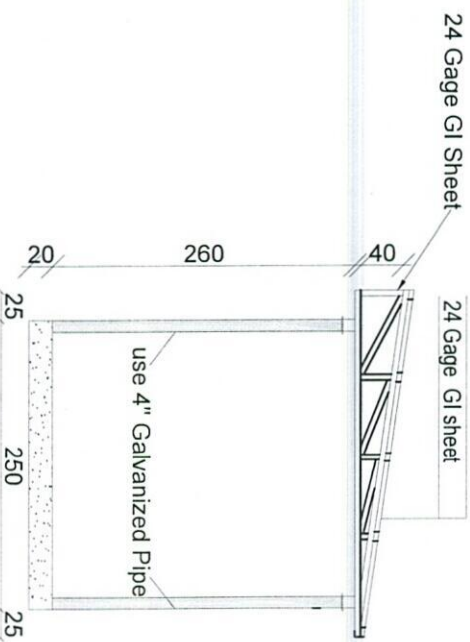

Section AA

REVISION NO	DATE	DESCRIPTION
01	24/02/2025	ISSUE FOR CONSTRUCTION

LEGEND:	SYMBOL	DESCRIPTION
CHANGED ROCK	CHANGED ROCK	CHANGED ROCK
POC	POC	POC

PROJECT TITLE / NO:
GSM SITES

DRAWING TITLE:
SUN SHELTER FOR GENERATOR

DRAWN BY:
CIVIL TEAM

CHECKED BY:

APPROVED BY:

SCALE: 1/75


ACTUAL DATE: 24/02/2025

ISSUE DATE: 24/02/2025


DRG.NO: 03

OWNER: ATGHAN TELECOM


- Notes:
1. The foundation is adopts reinforced concrete, the concrete is M20; (M20: compressive strength is 20N/mm2); the foundation lays on a 10cm thick crush stone pad;
 2. Ø12: mild steel, rebars strength 210N/mm2
 3. minimum concrete cover for rebar is 3.5cm,
 4. All units are in cm
 5. All edges of the Slab should be curve

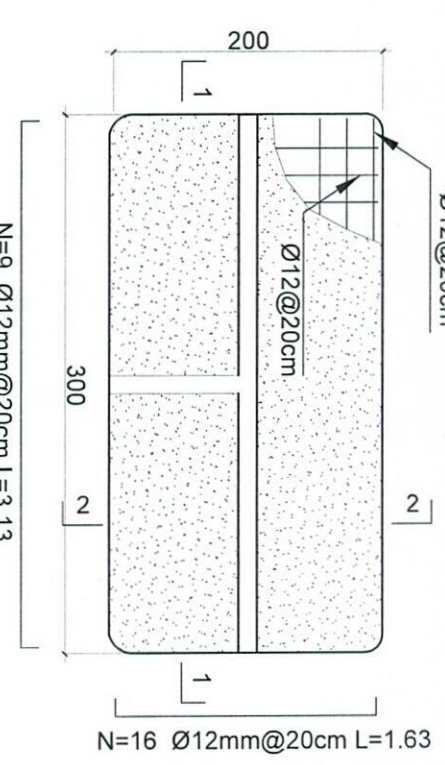

Outdoor BTS Foundation

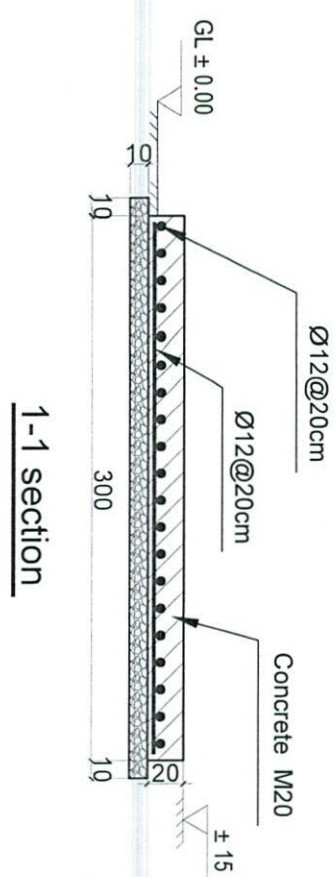

2-2 section

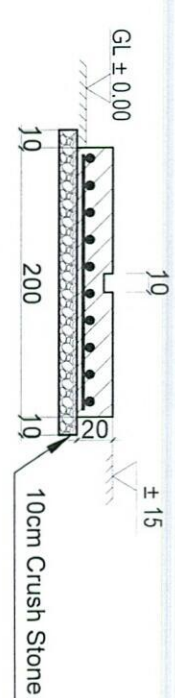

REVISION RECORDS			
NO	DATE	DESCRIPTION	REVISION
1	2023/05/25	ISSUE	01

LEGEND:

CRUSHED STONE	10cm
CONCRETE	M20
REBAR	Ø12mm@20cm
GROUND LEVEL	GL ± 0.00

PROJECT TITLE / NO:

GSM SITES

DRAWING TITLE:

ZTE OUTDOOR BTS FOUNDATION

DRAWN BY:

CHECKED BY:

APPROVED BY:

SCALE:


ACTUAL DATE:

ISSUE DATE:

OWNER:


AFGHAN TELECOM

Sakem Telecommunication Company
AFGHANISTAN

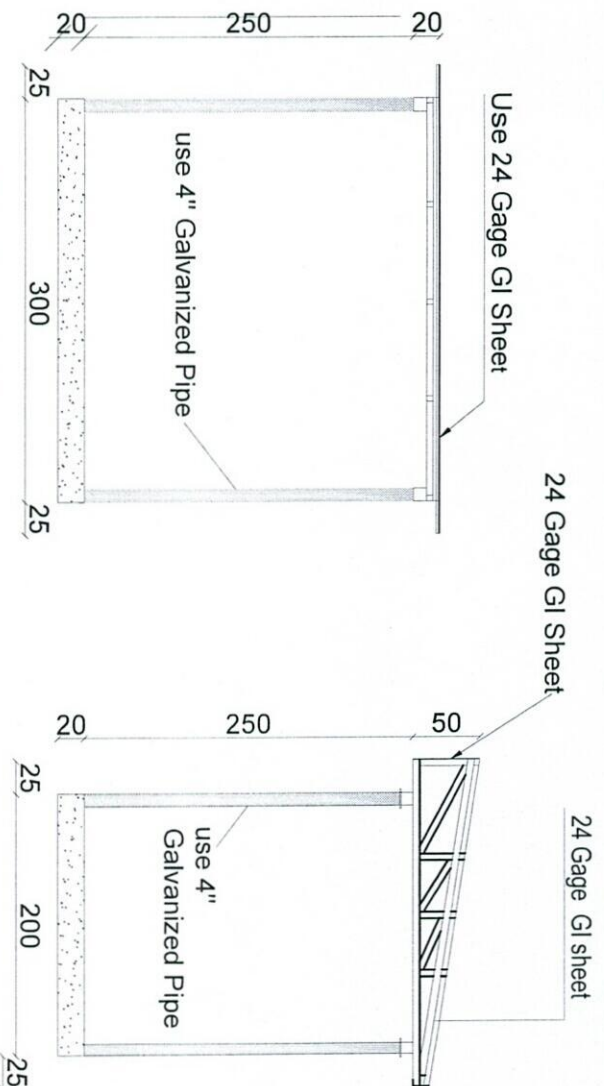

Section BB

Section AA

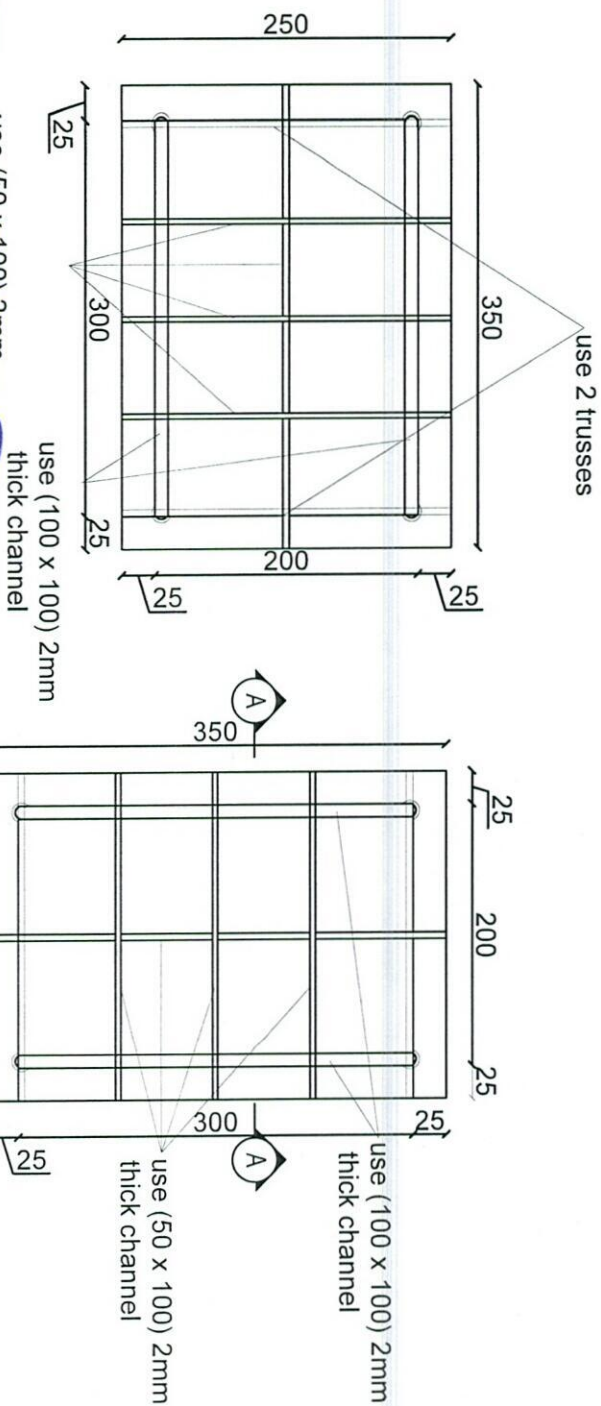

SUN SHELTER FOR ZTE BTS
REF: A105

use (50 x 100) 2mm
SCAFFOLD channel

use (100 x 100) 2mm
thick channel

REVISION RECORDS			
REVISION NO	DATE	DESCRIPTION	
01	2023/03/20	Initial Design	

LEGEND:	
	GRADED ROCK
	FILL

PROJECT TITLE / NO:
GSM SITES
کارخانه های GSM

DRAWING TITLE:

SUN SHELTER FOR ZTE BTS
بناگاه آنتن های ZTE

DRAWN BY:
CIVIL TEAM


CHECKED BY:

APPROVED BY:

SCALE: 1:50
ACTUAL DATE: 2023/03/20
ISSUE DATE: 2023/03/20
DRG NO: 05


OWNER:
AFGHAN TELECOM

Salam Telecom Company
KARUL
AFGHANISTAN

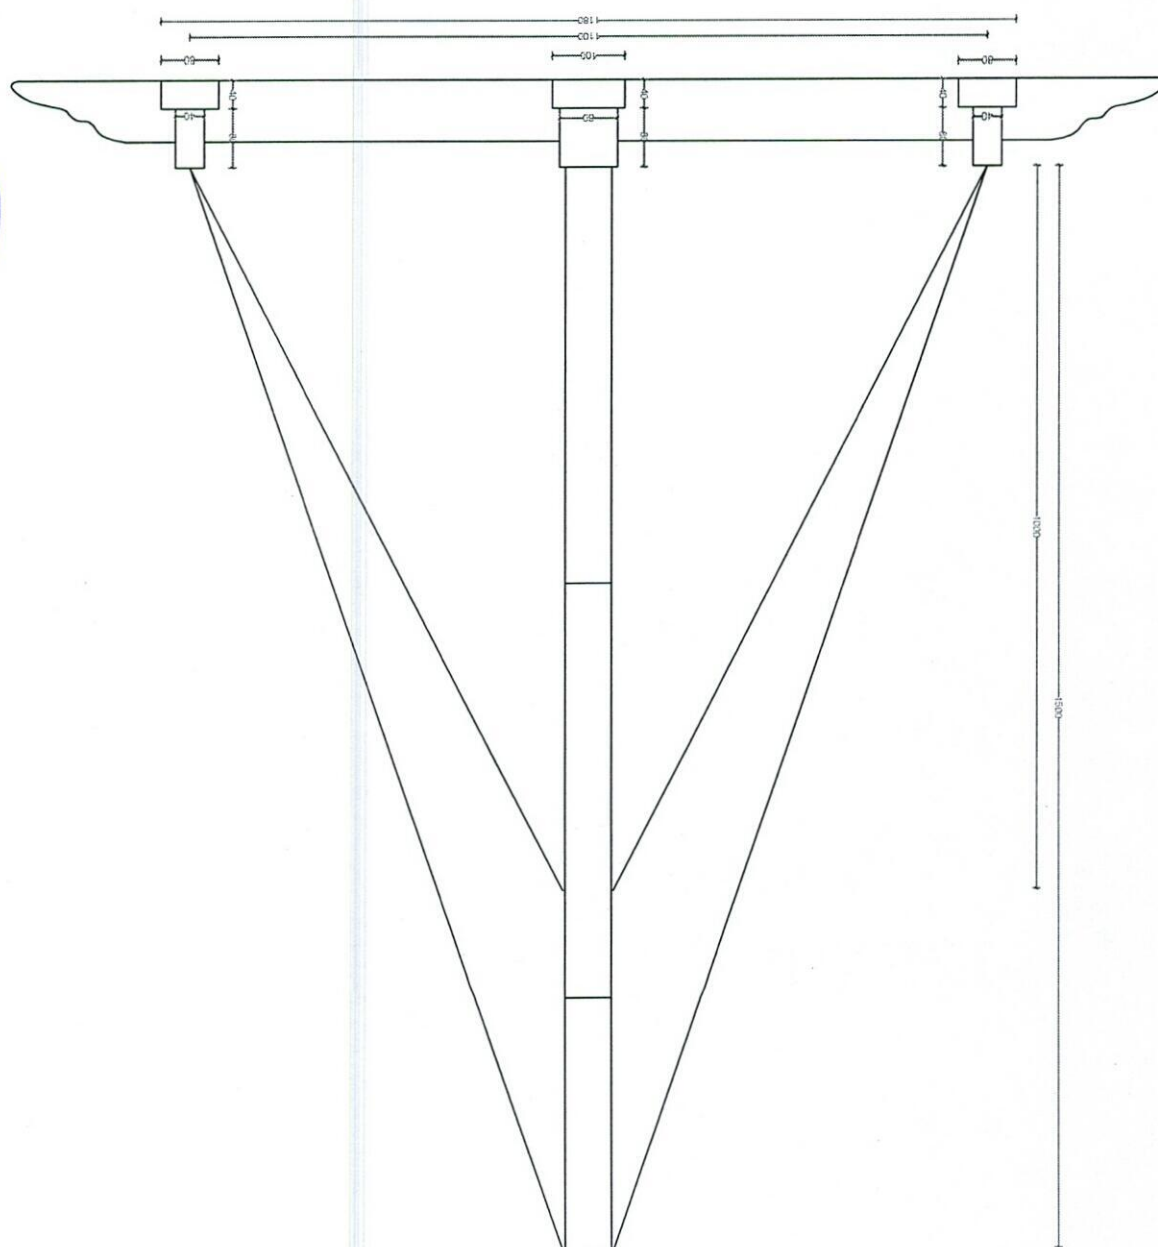

100


Guyed Tower Foundation -1

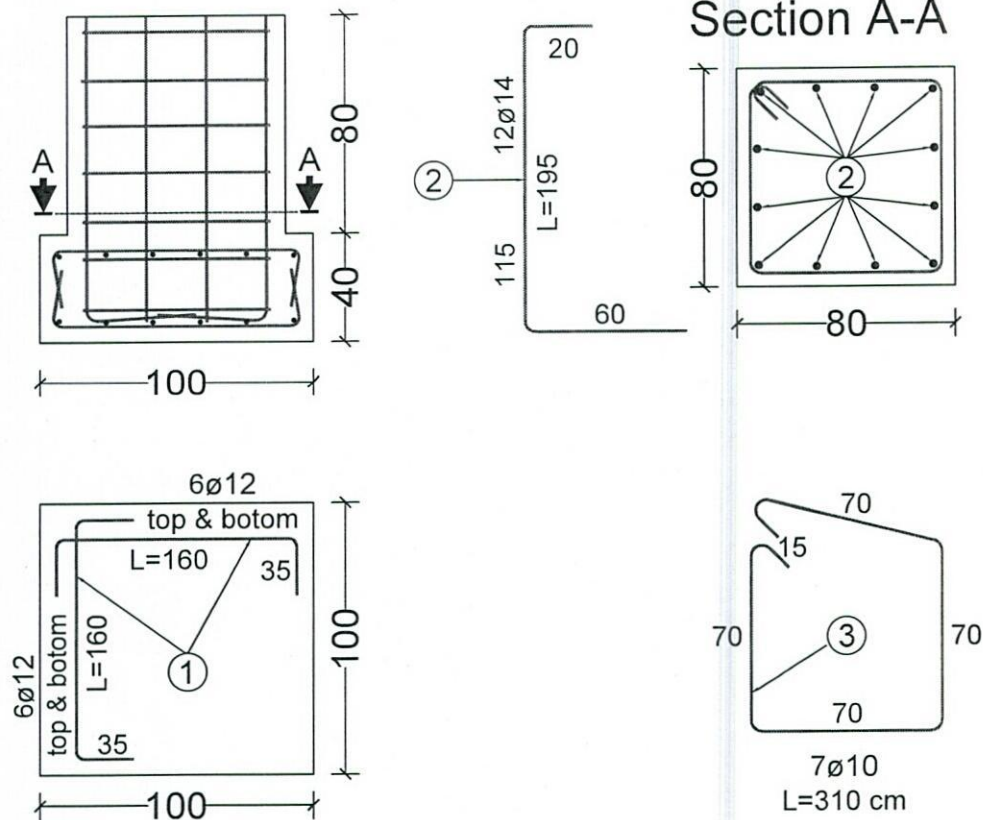

15m - Guyed Tower Foundation -1 (For One Foundation)					
BAR TYPE	DIA (mm)	LENGHT (cm)	NO OF BARS	UNIT WT (kg/m)	TOTAL WT (kg)
1	Ø12	160	24	0.89	34.18
2	Ø14	195	12	1.21	28.31
3	Ø10	310	7	0.62	13.45
TOTAL WEIGHT OF STEEL. (kg)					75
LEAN CONCRETE VOLUME. (Cu.m)					0.12
REINFORCED CONCRETE VOLUME. (Cu.m)					0.912
EXCAVATION. (Cu.m)					2.9
REINFORCEMENT STEEL.					S420
CONCRERE.					C20

[Handwritten signature]

Foundation For Cable - 2

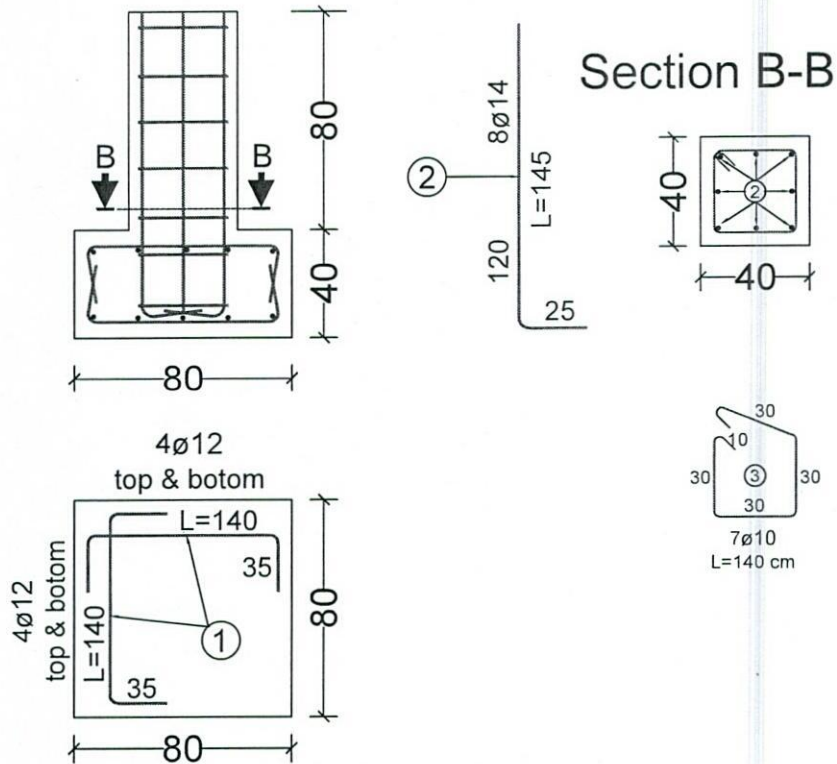


15m - Foundation For Cable -2 (For One Foundation)					
BAR TYPE	DIA (mm)	LENGHT (cm)	NO OF BARS	UNIT WT (kg/m)	TOTAL WT (kg)
1	ø12	140	16	0.89	19.94
2	ø14	145	8	1.21	14.04
3	ø10	140	7	0.62	6.08
TOTAL WEIGHT OF STEEL. (kg)					40
LEAN CONCRETE VOLUME. (Cu.m)					0.12
REINFORCED CONCRETE VOLUME. (Cu.m)					0.4
EXCAVATION. (Cu.m)					1.61
REINFORCEMENT STEEL.					S420
CONCRERE.					C20

[Handwritten signature]




Section (1)

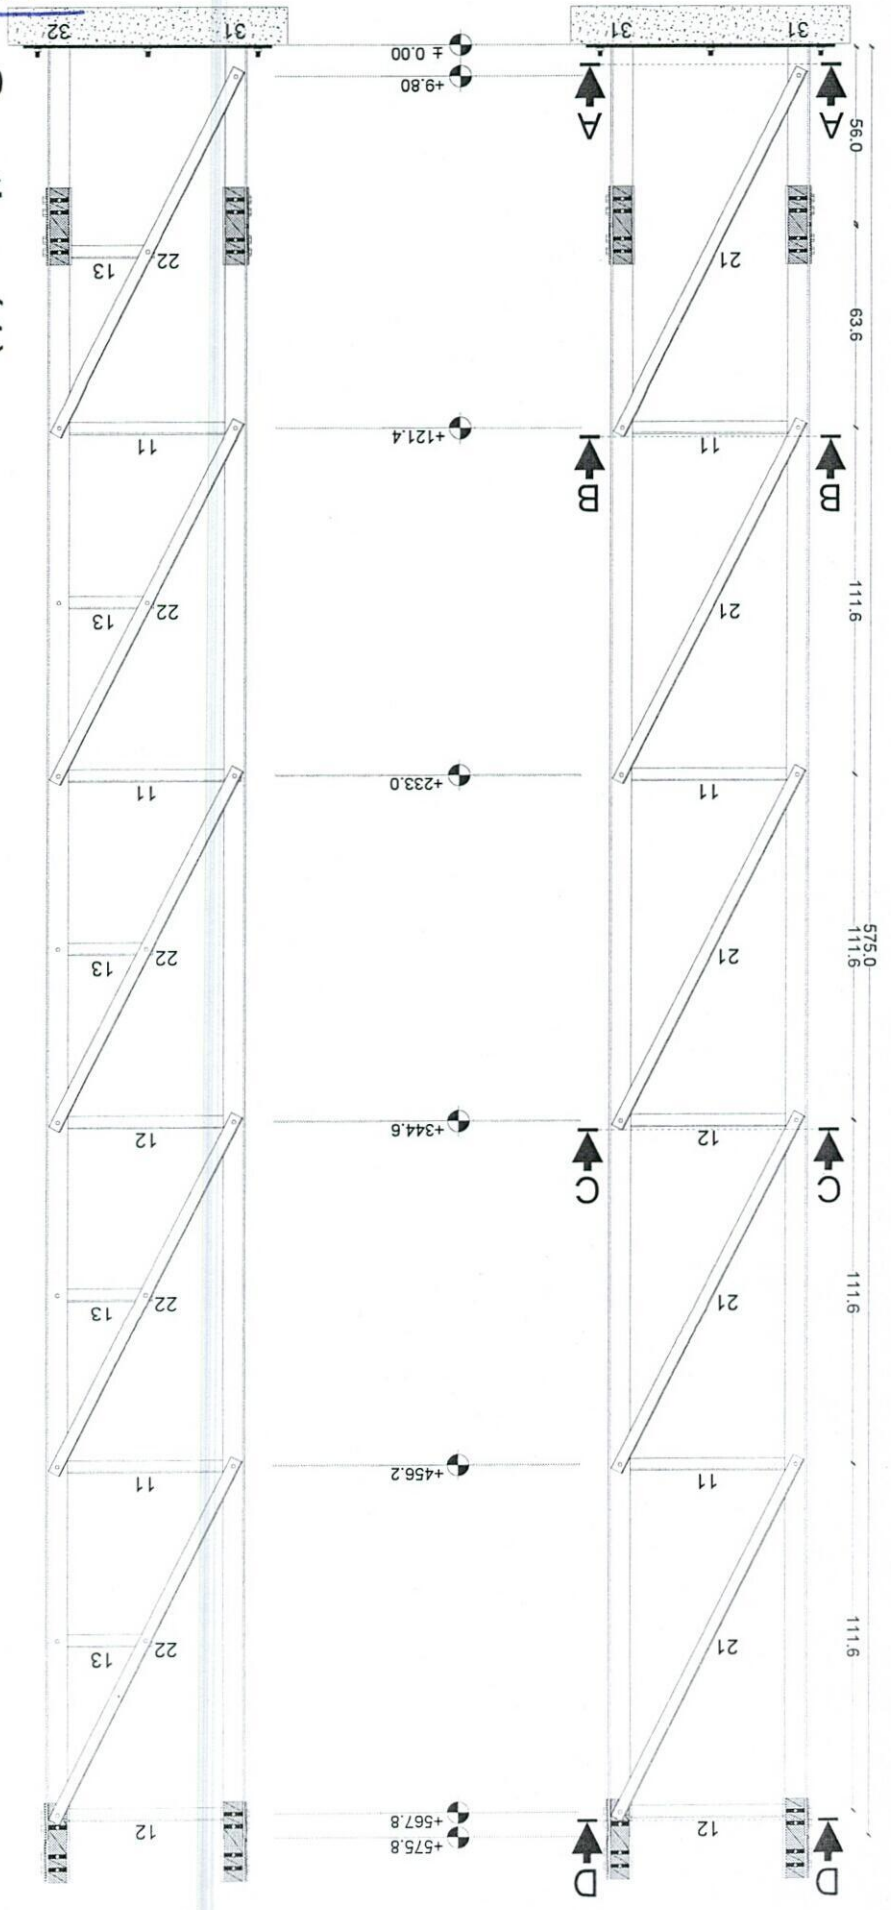


Handwritten signature or mark.

Section (2)





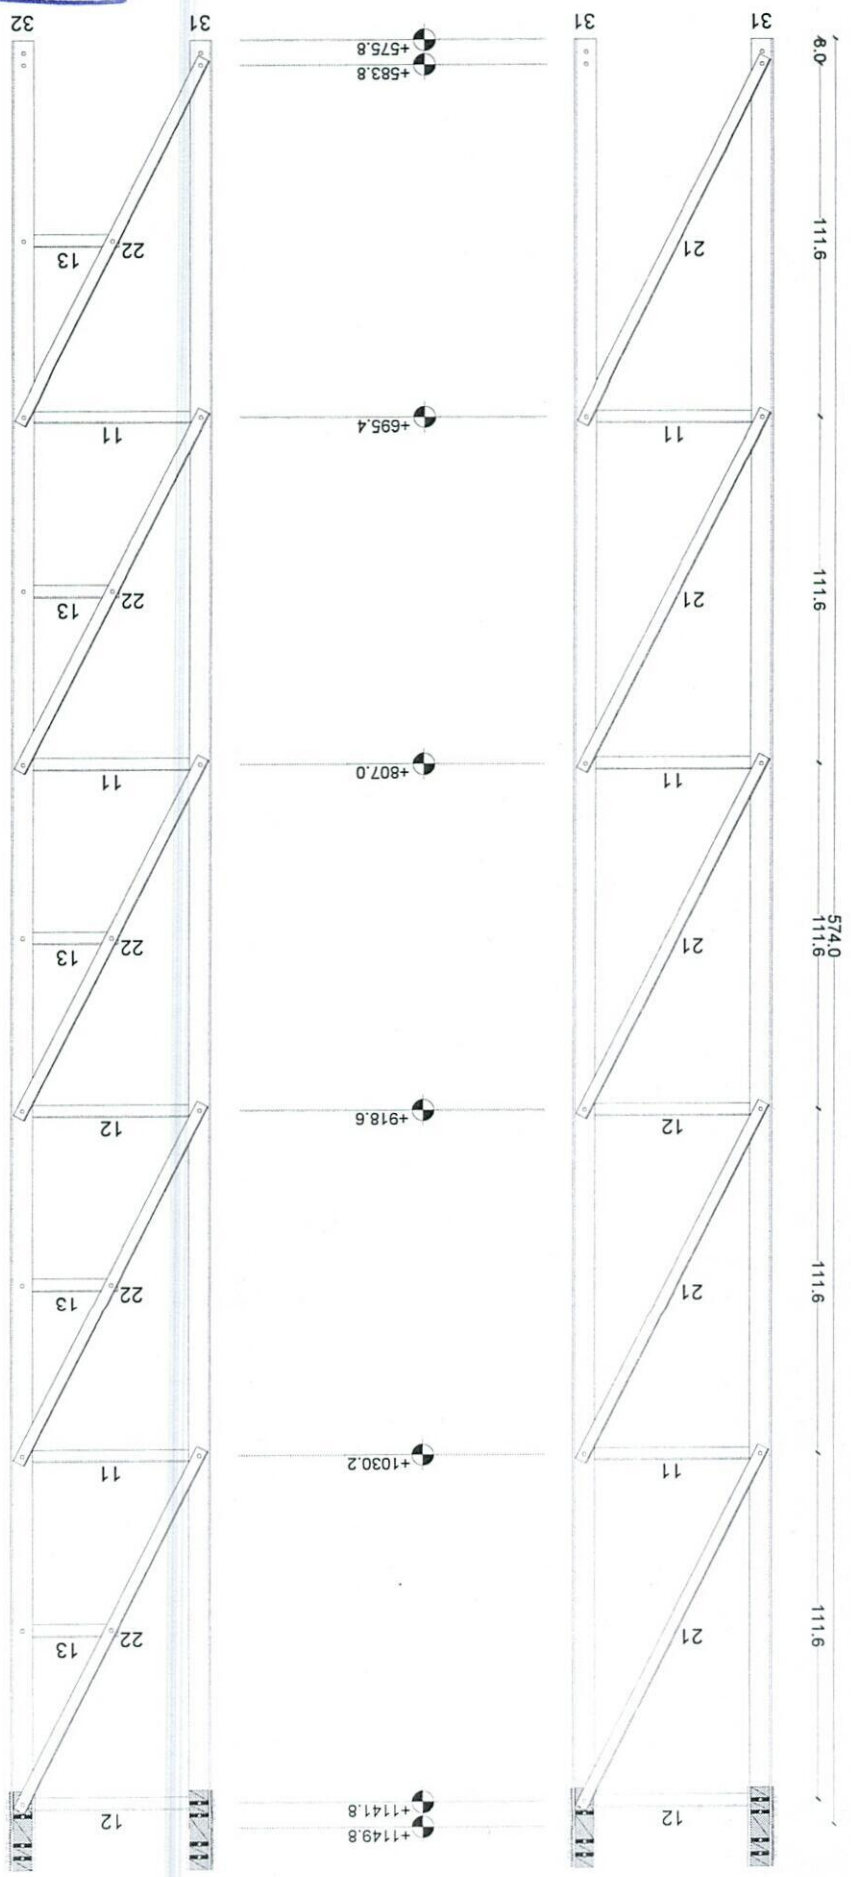




Section (3)

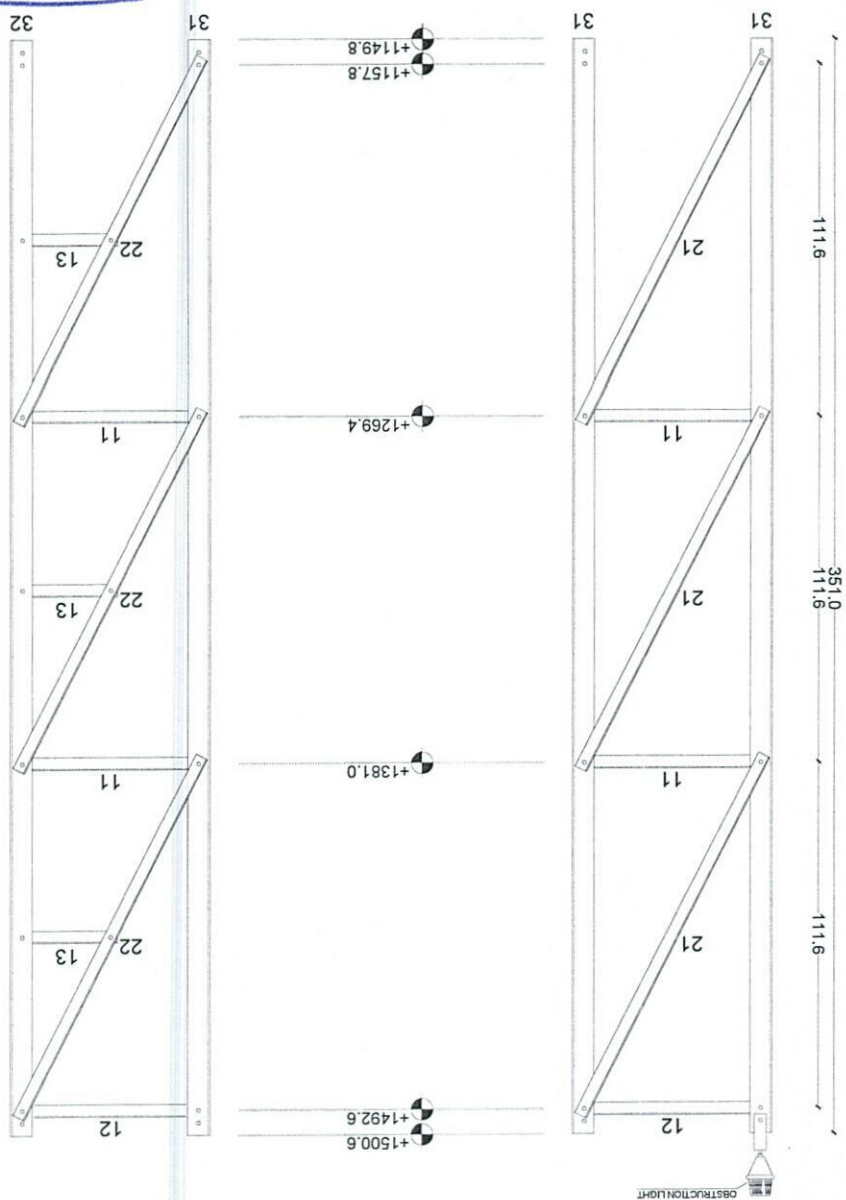

Parts Detail

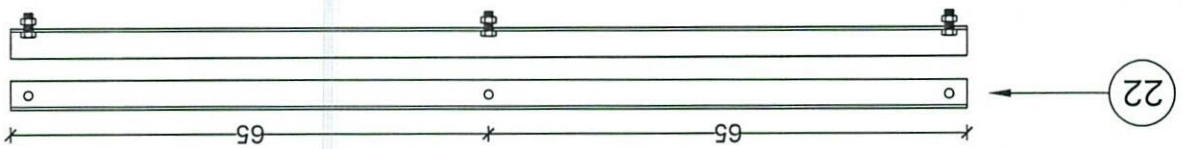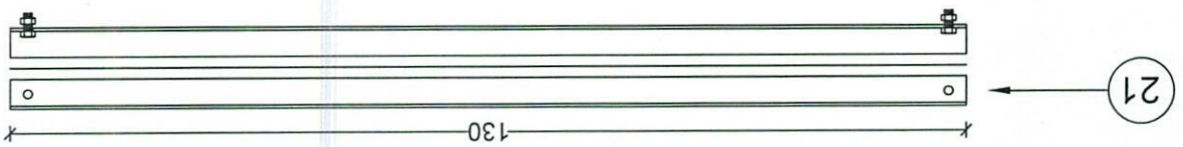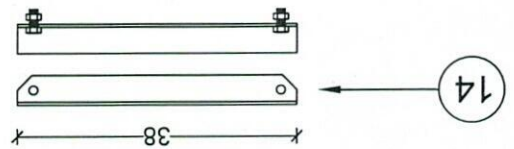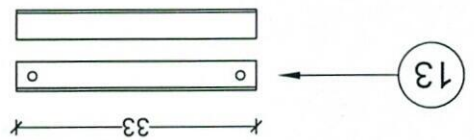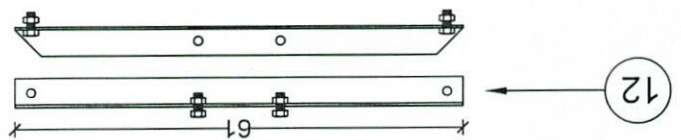

Section Detail

